

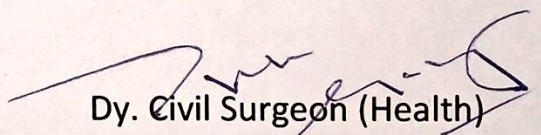
Office of the Civil Surgeon, Rohtak

Hygienic & Sanitation Certificate

NO:- CS-RTK/HEALTH/2025/680

Date: 30/12/2025

An application for Hygienic & Sanitation Certificate was received from **VIKRAMADITYA GLOBAL SCHOOL, MORKHERI, Rohtak** in the office of Civil Surgeon, Rohtak. The Distt. Inspection committee Health inspected the School on dated **30/10/2025** for physical verification of infrastructure and other hygienic measure adopted by concern institute. The inspection team found that there is adequate space & well ventilated. The rooms of school and vicinity area are neat and clean. There is adequate facility of drinking water & urinal etc. for students and staff. It is concluded that the hygienic and sanitary conditions of the building are satisfactory. This NOC is Valid form **03/11/2025 to 02/11/2026**.


Dy. Civil Surgeon (Health)

Dy. (Rohtak) (Health)
Rohtak

Memo No:- 536

Date:- 23/04/2026

Subject : Physical / Chemical Examination Report of Water Sample

Sample ID/Classification : RTK/00467/4/2026 / Private	Sample Details	Date & Time
Sender : VIKRAMADITYA GLOBAL SCHOOL	Collected By	Rohit Hooda
Location : , VPO. Morkheri (Sampla) Rohtak 124406	Collection Date	21/04/2026 at 10:24
Sample Description : Drinking Water	Received at lab	22/04/2026 at 13:02
Latitude / Longitude : 76.799927 / 28.849466	Analysis Start Date	23/04/2026
	Analysis End Date	23/04/2026
	Sample Quantity	2ltr

Test Result (As Per BIS 10500 :2012)

S.No.	Tested Parameter	Result	Requirement (Acceptable Limit)	Permissible Lmt. (In the Absence of Alternate Source)	Protocol Used
1	Turbidity	3.64	1 NTU	5 NTU	APHA 24th Edition -2130 B
2	Taste	Agreeable	Agreeable	Agreeable	IS 3025 (Part-8) : 2023
3	Odour	Agreeable	Agreeable	Agreeable	IS 3025 (Part-5) : 2018
4	Color	10	5 Hazen Units	15 Hazen Units	APHA 24th Edition-2120-B
5	Total Dissolved Solids @ 180°C ± 2°C	1600	500 mg/lit.	2000 mg/lit.	IS 3025 (Part-16) : 2023 /APHA 24th Edition-2540 C
6	Total Hardness as CaCo3	447.48	200 mg/lit.	600 mg/lit.	APHA 24th Edition -2340 C
7	Calcium as Ca	59.51	75 mg/lit.	200 mg/lit.	APHA 24th Edition-3500-Ca B
8	Magnesium as Mg	72.65	30 mg/lit.	100 mg/lit.	APHA 24th Edition -3500 Mg B
9	Total Alkalinity	312	200 mg/lit.	600 mg/lit.	APHA 24th Edition -2320 B
10	Chloride as Cl	372.47	250 mg/lit.	1000 mg/lit.	APHA 24th Edition -4500 Cl-B
11	Sulphate as So4	189	200 mg/lit.	400 mg/lit.	USEPA
12	Fluoride as F	0.48	1.0 mg/lit.	1.5 mg/lit.	USEPA
13	Iron as Fe	0.06	1.0 mg/lit.	1.0 mg/lit.	USEPA
14	pH @ 25°C	8.11	6.5 - 8.5	6.5 - 8.5	APHA 24th Edition 4500-H+ B
15	Free Residual Chlorine	00	0.2 mg/lit.	1.0 mg/lit.	

Remarks :-

- * The Results Given above are related to the sample as received and tested in PHED ROHTAK Lab.
- * The test report can't be regenerated in whole or part there of without written permission of Competent Authority.
- * The test report can't be used for any publicity or any legal purpose.
- * Reliability of water sample sample lies with sender/collector of water sample.
- * To check the sample report online Scan the QR Code below.
- * The test samples meant for chemical analysis will be disposed off after 7 days from the data of issue of test report unless until specifically requested by the customer for retaining over a longer period.

Water Sample has been found "**CONFORMING**" to Limits set in BIS10500:2012 for the tested parameters.



Sample analyzed by :

SONIA ,CHEMIST
DISTRICT WATER TESTING LABORATORYROHTAK
email:-chemist.rohtak@phedharyana.gov.in